


# COMMERCIAL METER SET

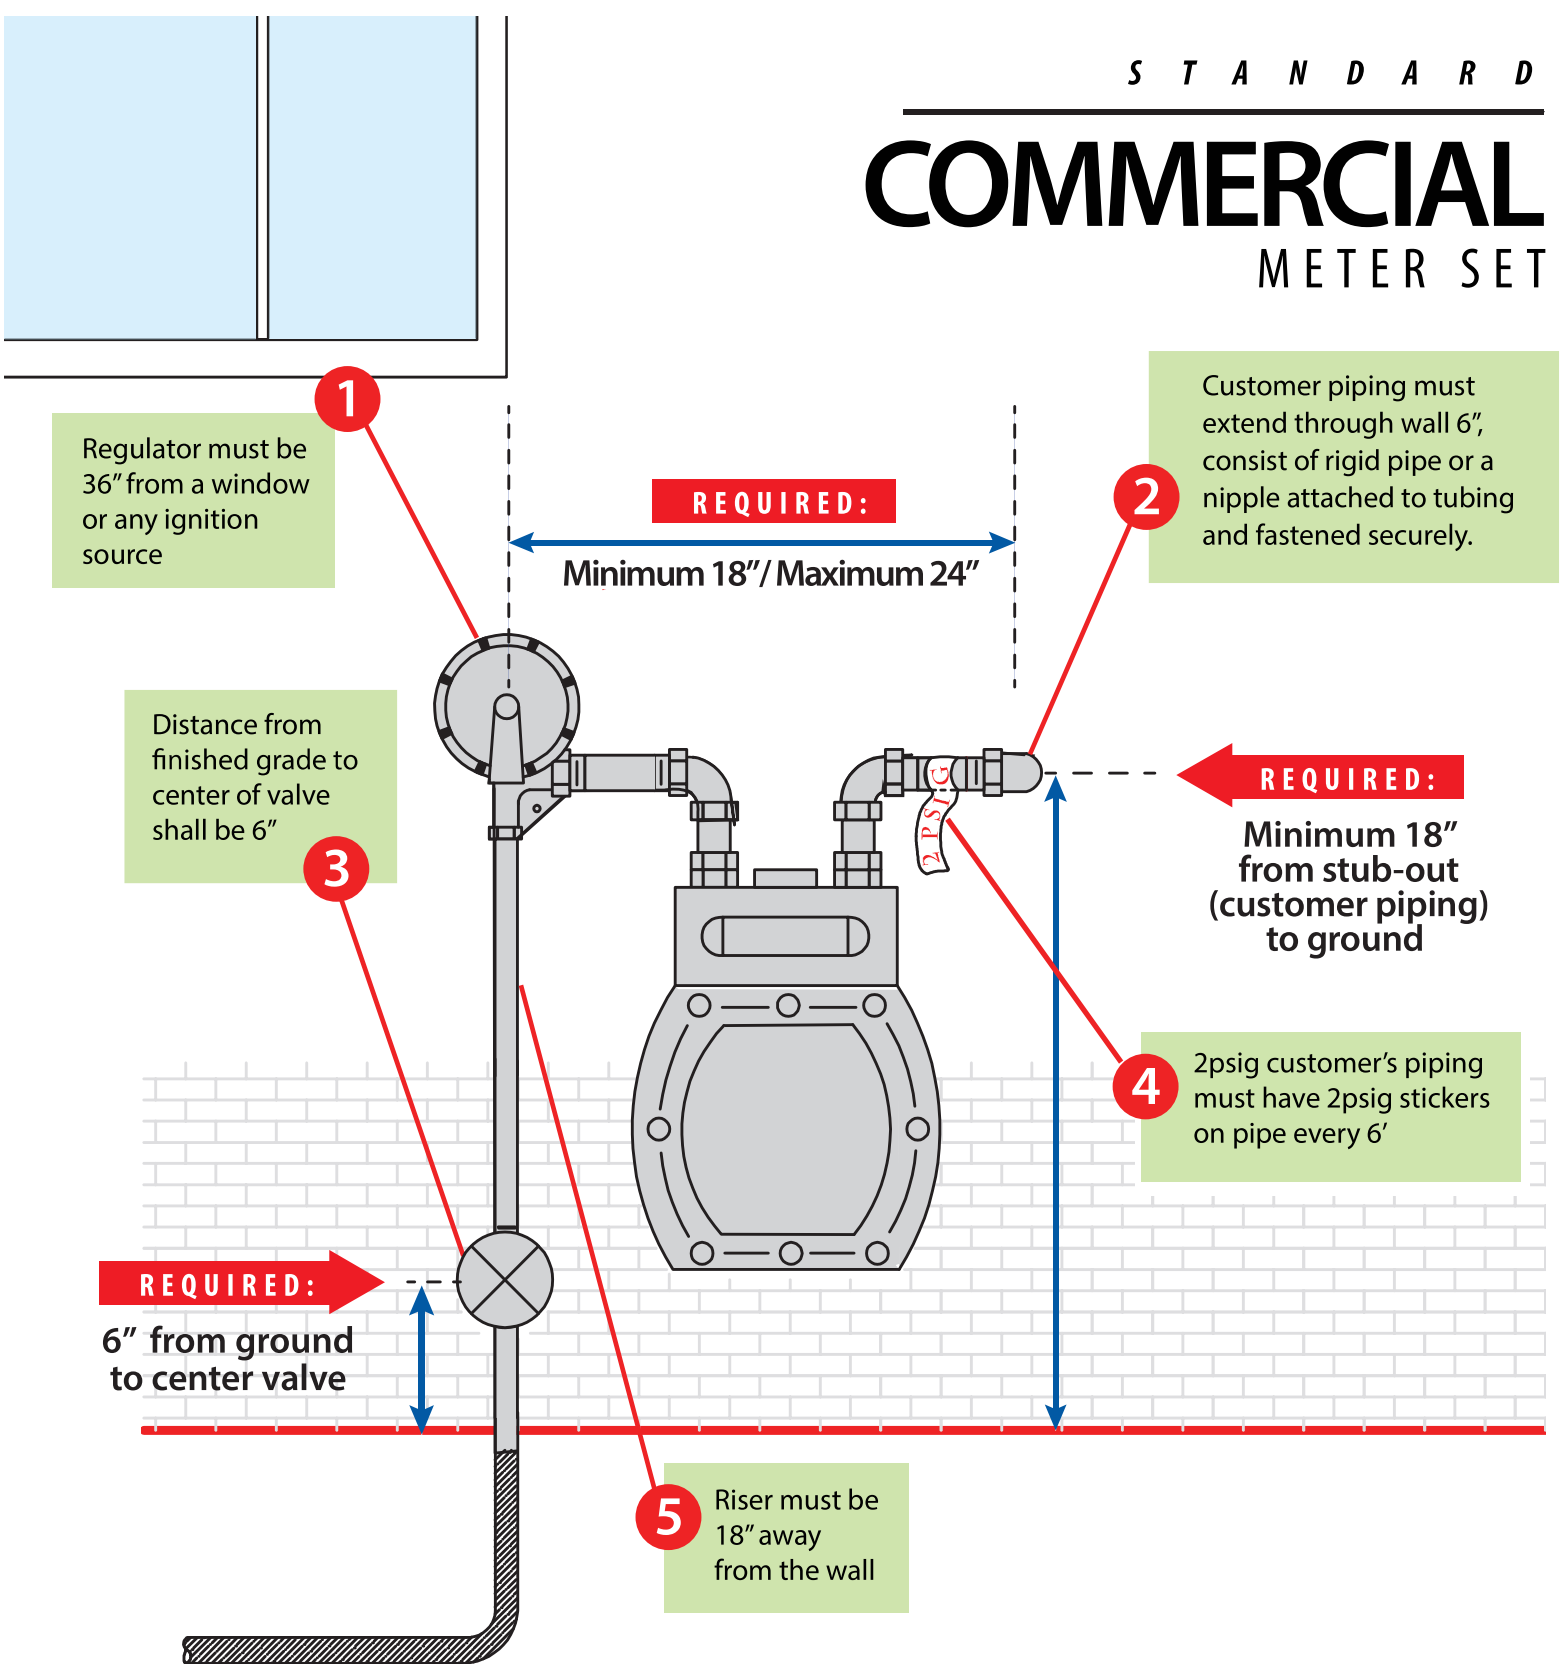

1  
Regulator must be 36" from a window or any ignition source

2  
Customer piping must extend through wall 6", consist of rigid pipe or a nipple attached to tubing and fastened securely.

3  
Distance from finished grade to center of valve shall be 6"

REQUIRED:  
Minimum 18" from stub-out (customer piping) to ground

4  
2psig customer's piping must have 2psig stickers on pipe every 6'

REQUIRED:  
6" from ground to center valve

5  
Riser must be 18" away from the wall



Benton Evenson  
BUSINESS DEVELOPMENT  
(803)323-5354

EMERGENCY: 1-866-201-1001