


COMMERCIAL METER SET

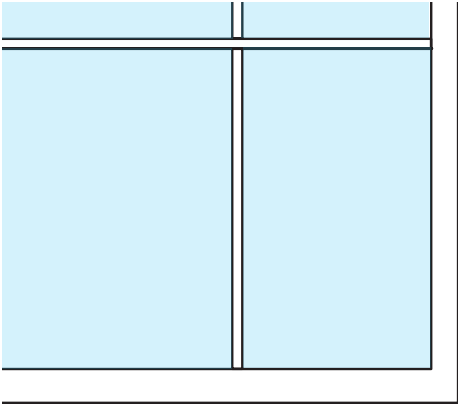

1
Regulator must be 36" from a window or any ignition source

REQUIRED:
12"

2
Customer's piping to each suite/location must be labeled

3
Customer piping must extend through wall 6", consist of rigid pipe or a nipple attached to tubing and fastened securely.


6
Distance from finished grade to center of valve shall be 6"

REQUIRED:
Minimum 18" from stub-out (customer piping) to ground

4
2psig customer's piping must have 2psig stickers on pipe every 6'

REQUIRED:
6" from ground to center valve

5
Riser must be 18" away from the wall

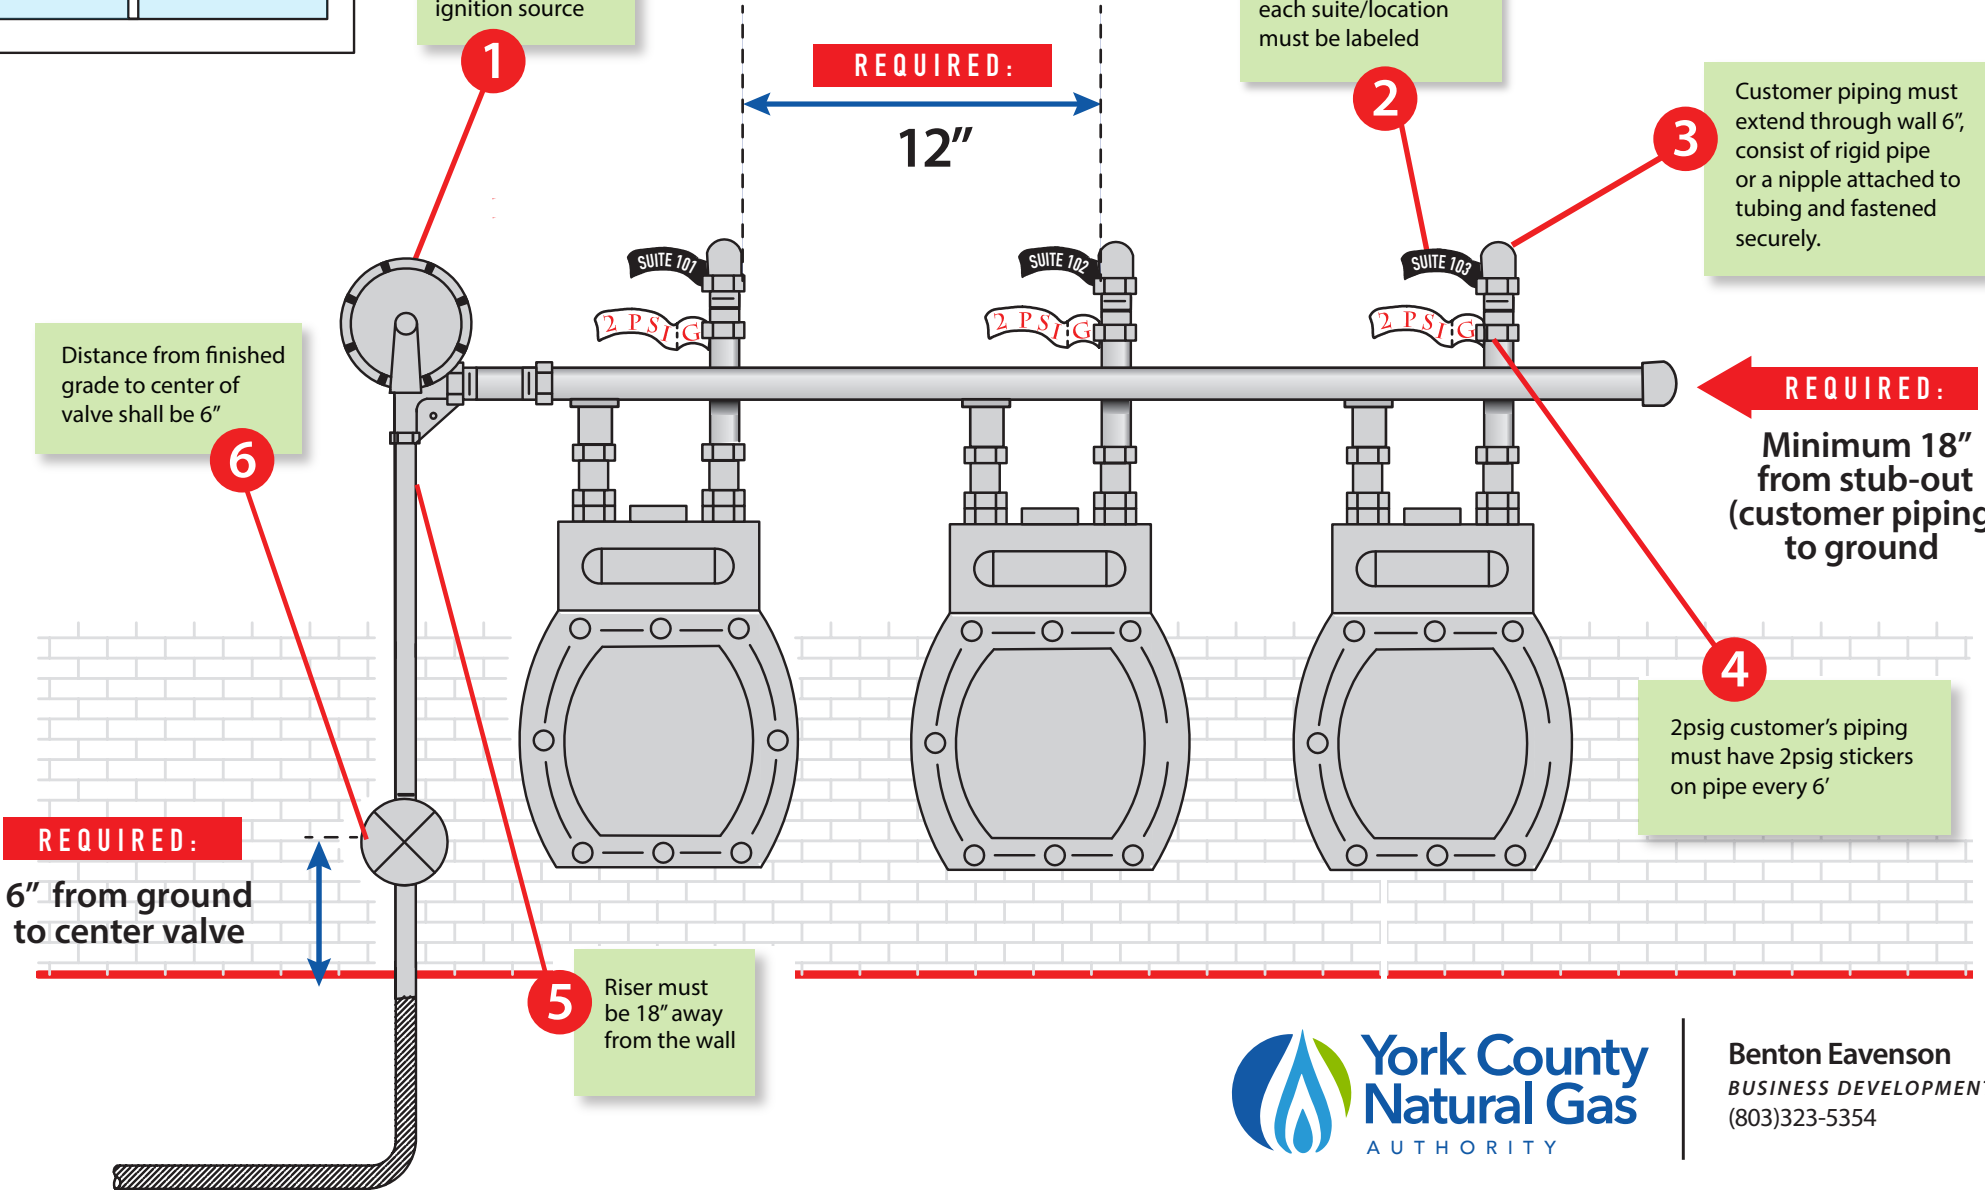

Benton Evenson
BUSINESS DEVELOPMENT
(803)323-5354